




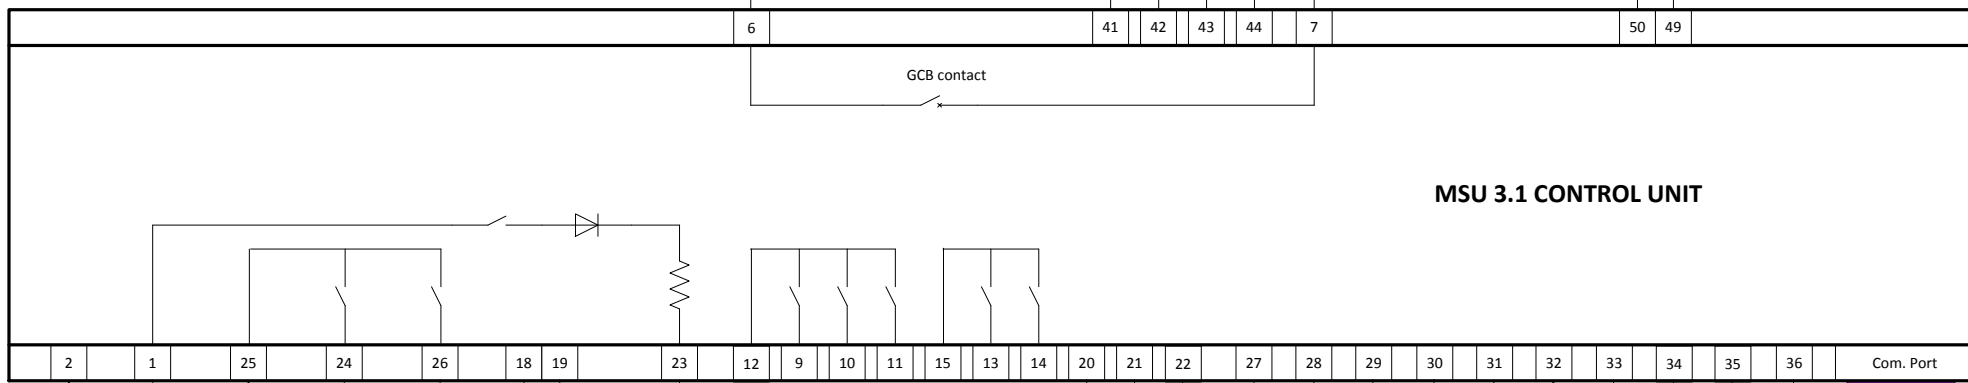


LOAD




GENERATOR

U
V
W
Mp



MSU 3.1 CONTROL UNIT

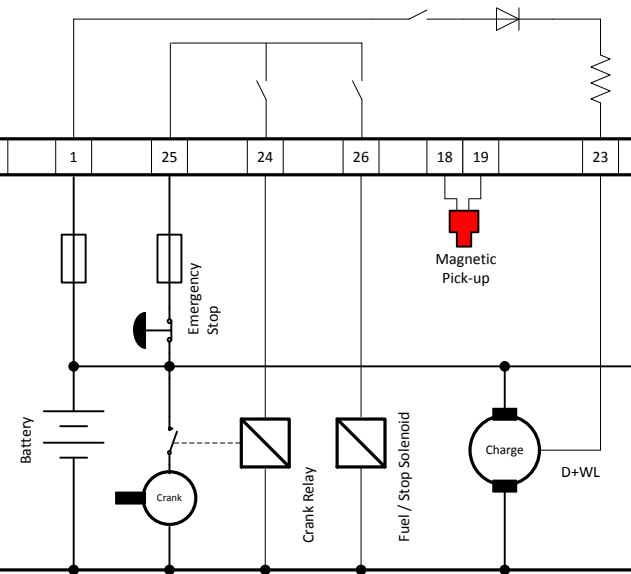

NEGATIVE TERMINAL OF THE BATTERY SHOULD BE GROUNDED

